


Option Module Installation: Fieldbus



CAUTION: Power down the drive before installing / removing option modules. Failure to do so may result in damage to the product. Refer to section *Safety Information* in the appropriate drive manual.

Figure 1-1 Installation of an SI option module on Unidrive M200 to M400 (sizes 2 to 4)

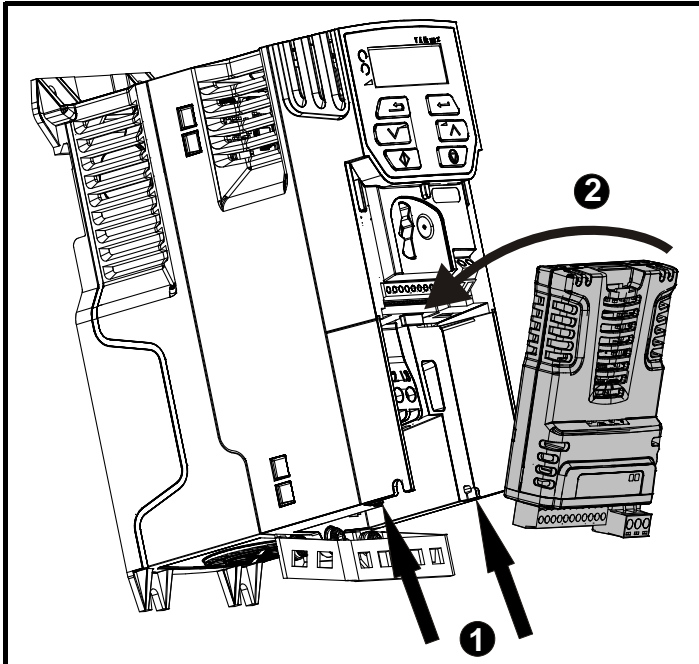


- With the option module tilted slightly backwards, align and locate the two holes in the rear of the option module onto the two tabs (1) on the drive.
- Place the option module onto the drive as shown in (2) until the module clicks into place. The terminal cover on the drive holds the option module in place, so this must be put back on.

NOTE


Option modules can only be installed on drives that have the option module slot functionality.

Figure 1-2 Installation of an SI option module on Unidrive M200 to M400 (sizes 5 to 8)

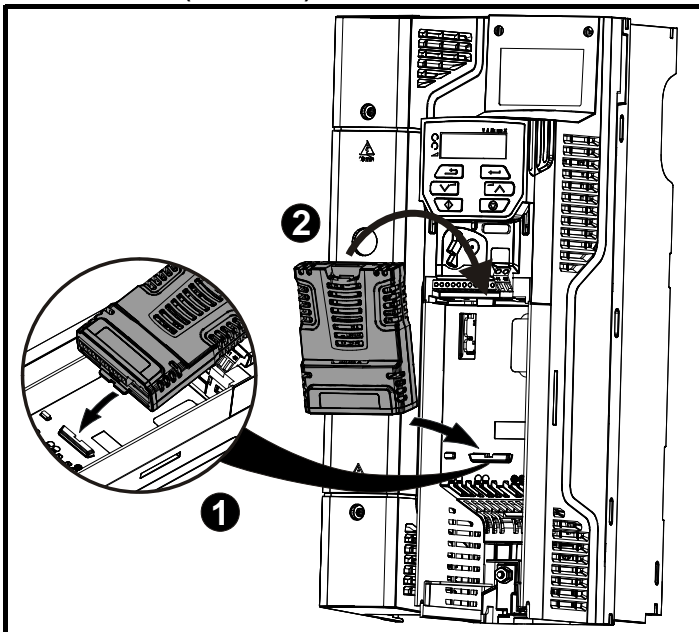

- Place the option module onto the drive as shown in (2) until the module clicks into place. The terminal cover on the drive holds the option module in place, so this must be put back on.

Figure 1-3 Installation of an SI option module on Unidrive M600 to M810

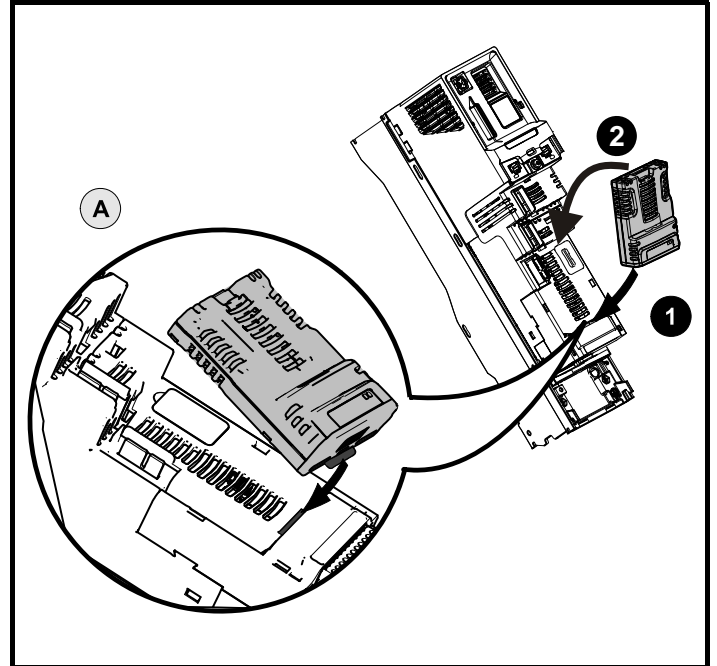
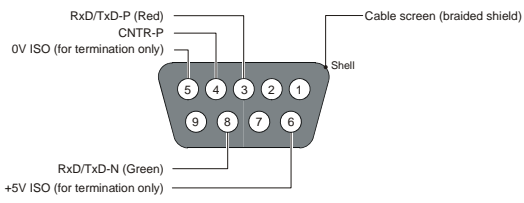

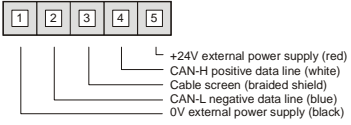

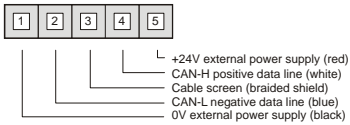








- Move the option module in direction shown (1/2).
- Align and insert the option module tab in to the slot provided, this is highlighted in the detailed view (A).
- Press down on the option module until it clicks into place.

NOTE

Option module slots must be used in the following order: Slot 3 (lower), Slot 2 (middle) and then Slot 1 (upper).



Module	Color	Terminal information																				
 <p>SI-PROFIBUS</p>	Purple	 <p>RxD/TxD-P (Red) CNTR-P 0V ISO (for termination only)</p> <p>RxD/TxD-N (Green) +5V ISO (for termination only)</p> <p>Cable screen (braided shield) Shell</p>																				
 <p>SI-DeviceNet</p>	Medium Grey	 <p>1 2 3 4 5</p> <p>+24V external power supply (red) CAN-H positive data line (white) Cable screen (braided shield) CAN-L negative data line (blue) 0V external power supply (black)</p>																				
 <p>SI-CANopen</p>	Light Grey	 <p>1 2 3 4 5</p> <p>+24V external power supply (red) CAN-H positive data line (white) Cable screen (braided shield) CAN-L negative data line (blue) 0V external power supply (black)</p>																				
 <p>SI-Ethernet</p>	Beige	 <p>Spade Connector</p> <div style="display: flex; justify-content: space-around; align-items: flex-start;"> <div style="text-align: center;"> <p>A</p>  </div> <div style="text-align: center;"> <p>B</p>  </div> <div style="text-align: center;"> <p>Link/Activity indicators</p> <p><input type="checkbox"/> <input type="checkbox"/></p> <p>A B</p> </div> </div> <table border="1" style="margin-top: 10px;"> <thead> <tr> <th>Ethernet</th> <th>Function</th> <th>Ethernet</th> <th>Function</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>Transmit +</td> <td>5</td> <td>Not used</td> </tr> <tr> <td>2</td> <td>Transmit -</td> <td>6</td> <td>Receive -</td> </tr> <tr> <td>3</td> <td>Receive +</td> <td>7</td> <td>Not used</td> </tr> <tr> <td>4</td> <td>Not used</td> <td>8</td> <td>Not used</td> </tr> </tbody> </table>	Ethernet	Function	Ethernet	Function	1	Transmit +	5	Not used	2	Transmit -	6	Receive -	3	Receive +	7	Not used	4	Not used	8	Not used
Ethernet	Function		Ethernet	Function																		
1	Transmit +		5	Not used																		
2	Transmit -		6	Receive -																		
3	Receive +	7	Not used																			
4	Not used	8	Not used																			
 <p>SI-PROFINET RT</p>	Yellow Green																					
 <p>SI-EtherCAT</p>	Brown Red																					

For full details on any of the option modules, please refer to the appropriate option module user guide.

